



Average Energy Prices DA vs. RT


ERCOT-wide

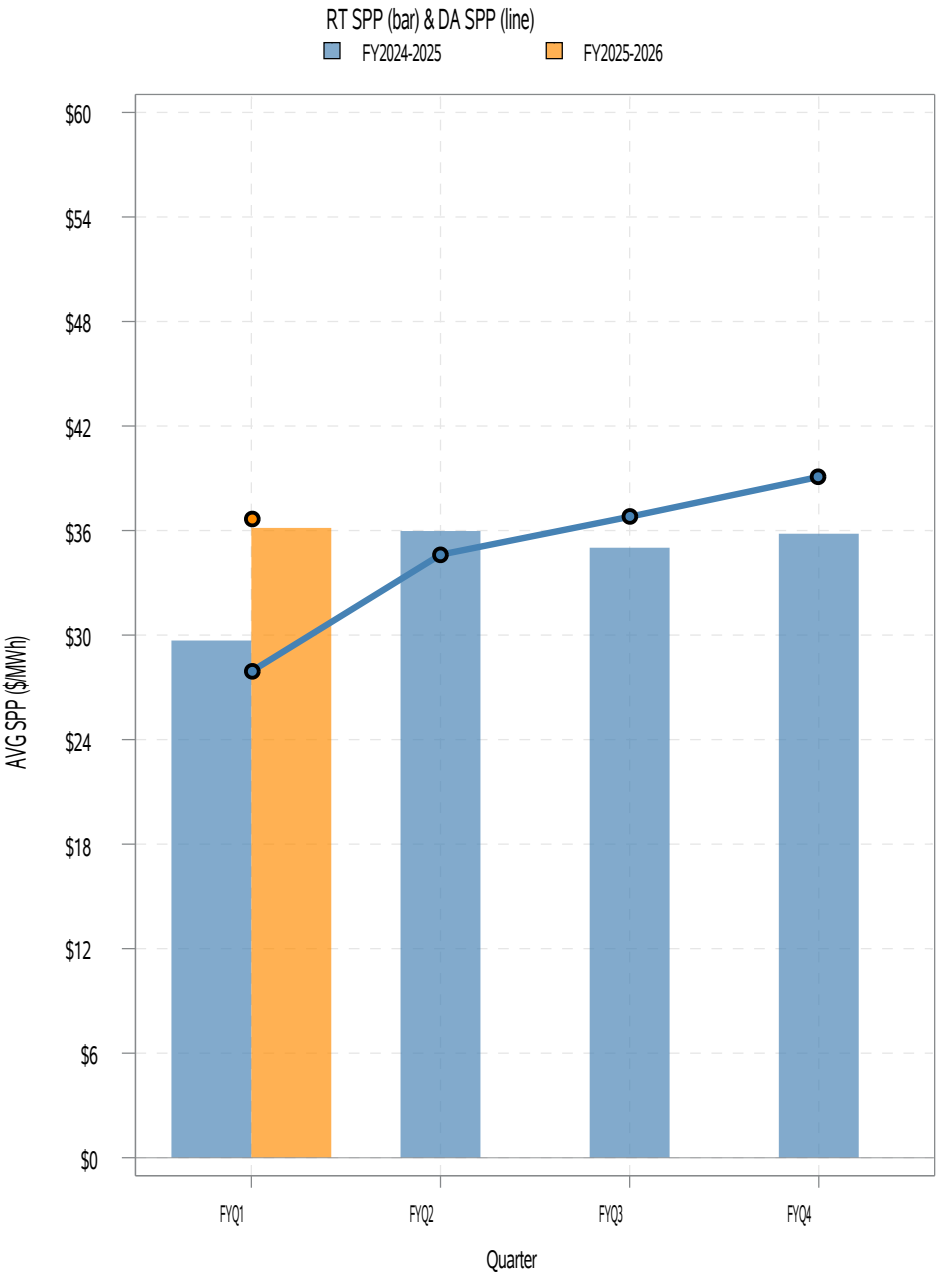


LZ Houston

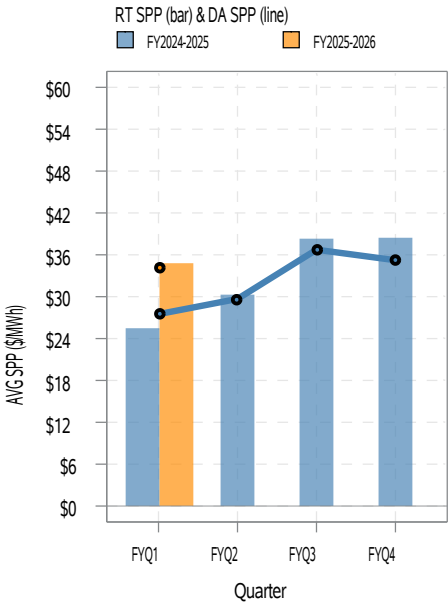


LZ North

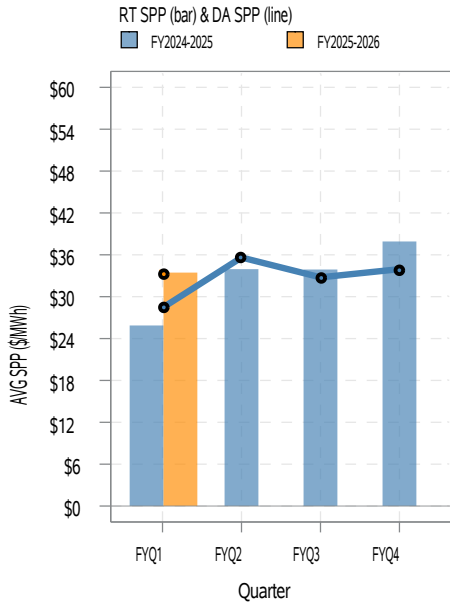


LZ South

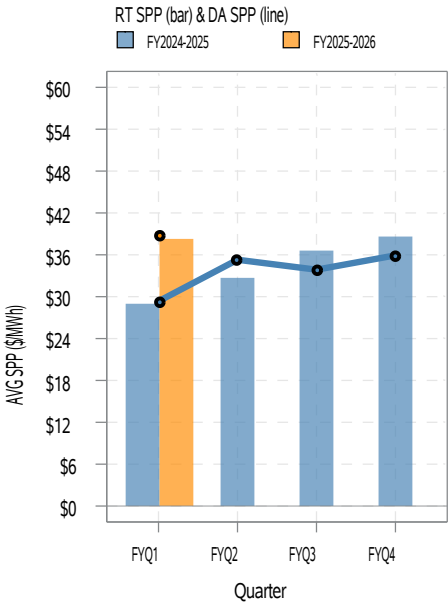





LZ West

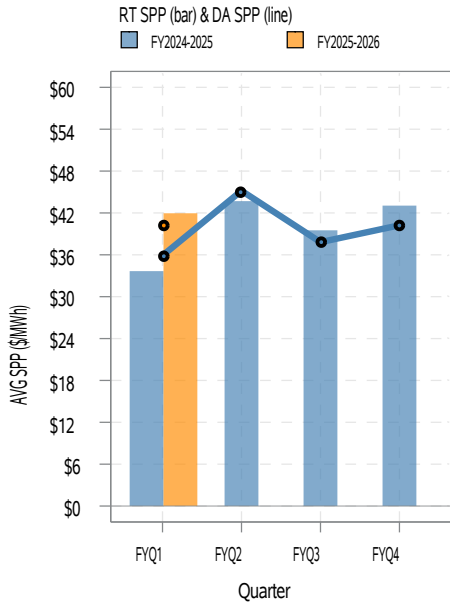


Average Heat Rates DA vs. RT

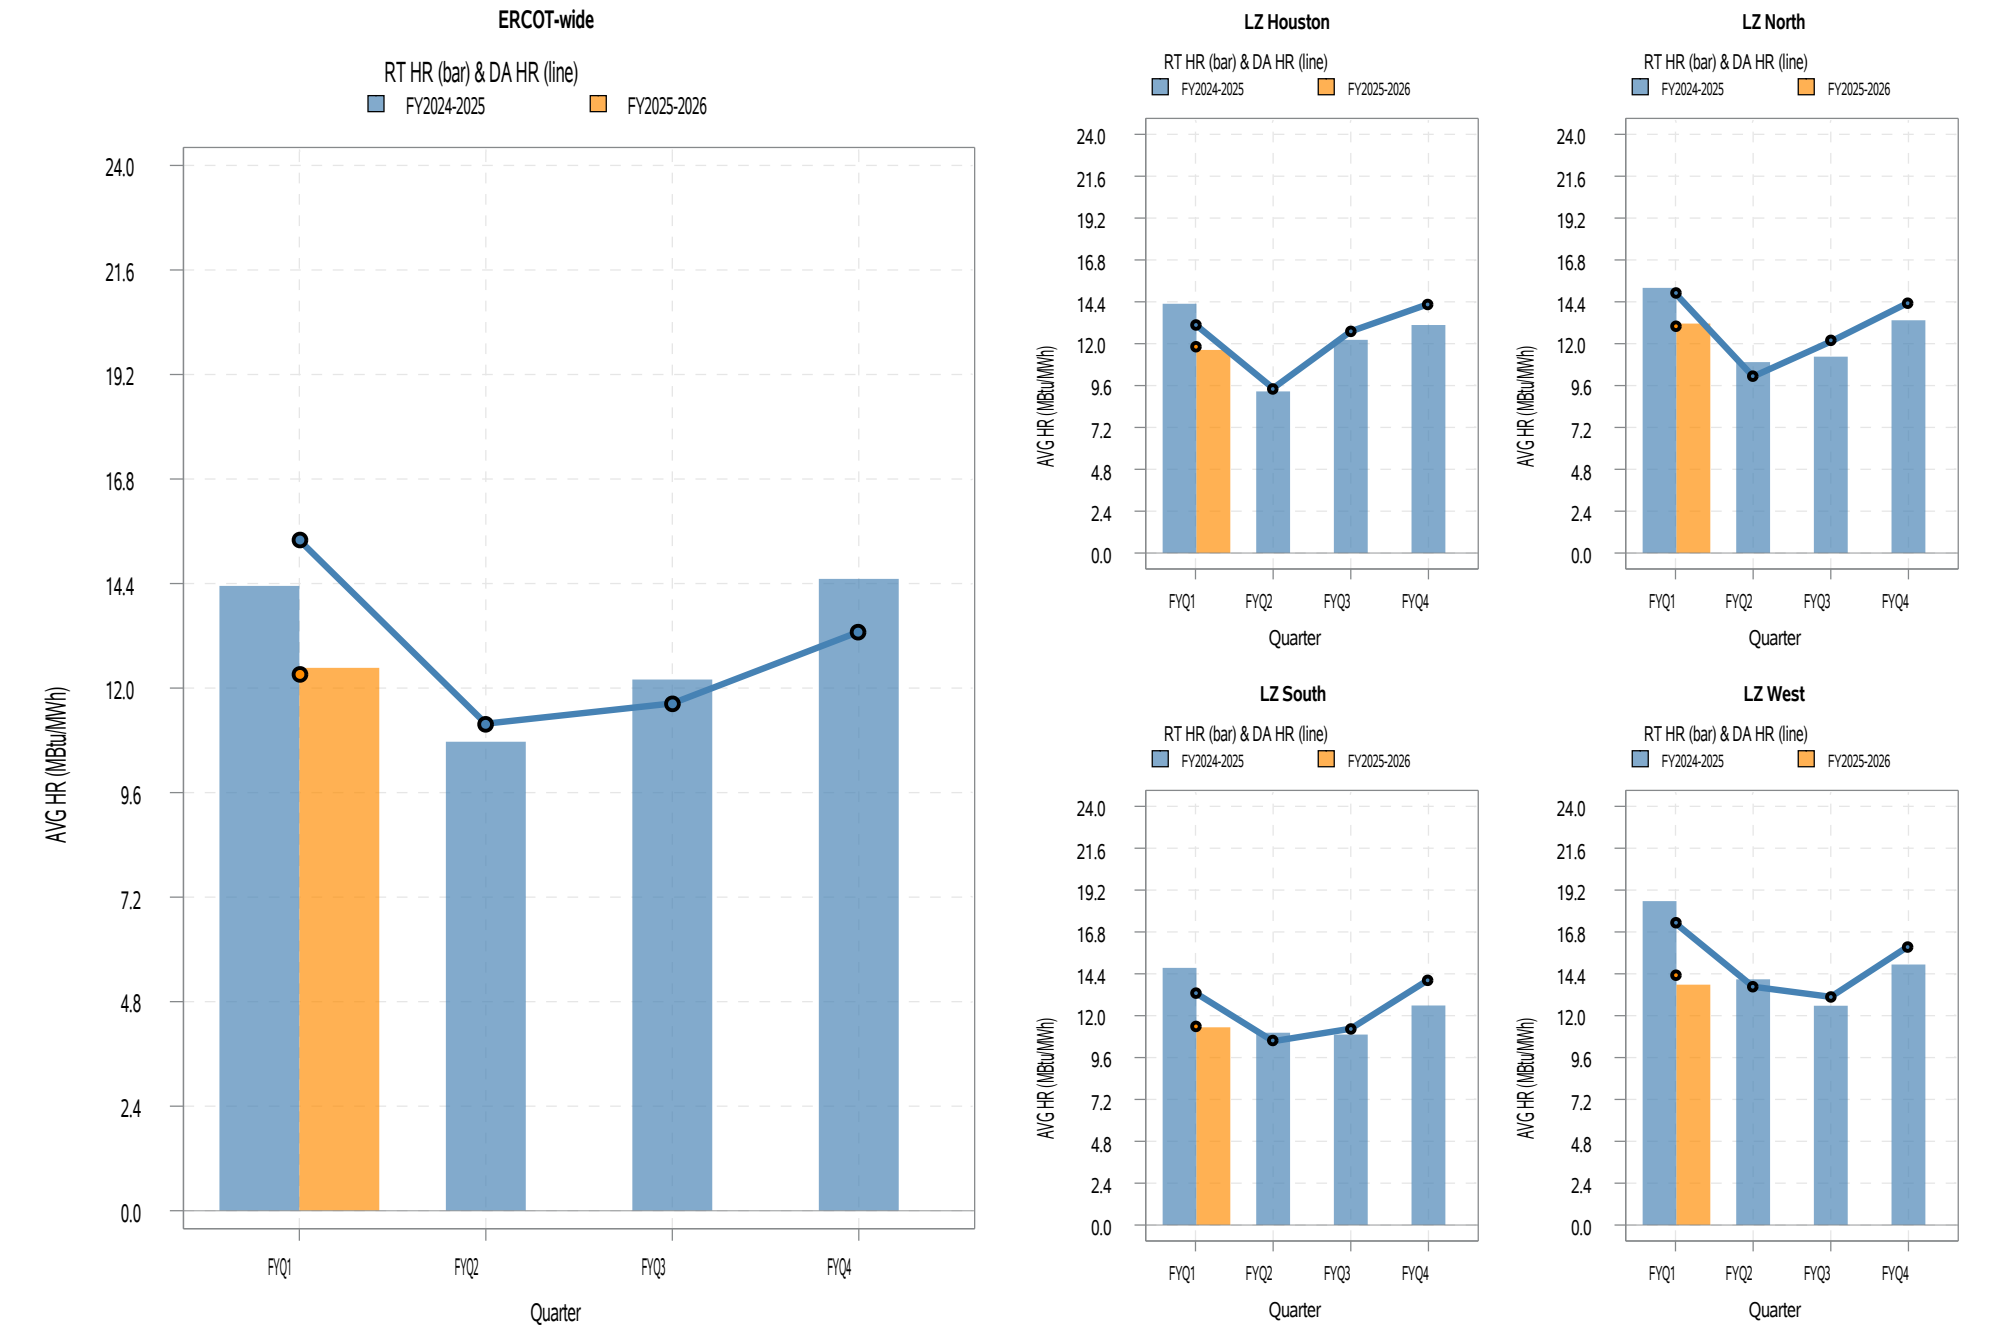






Load Zone Loads Averages vs. Peaks

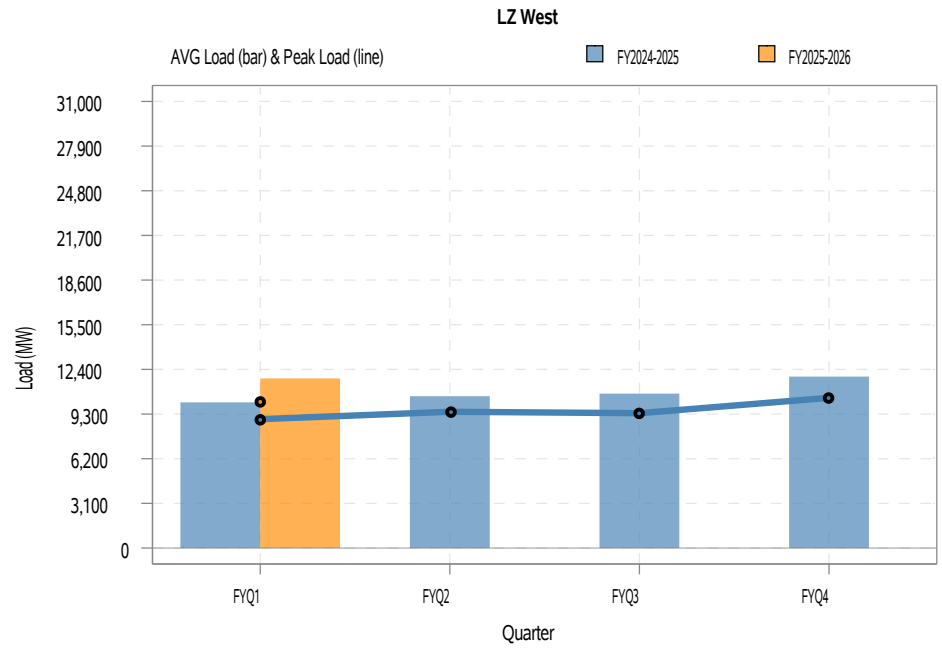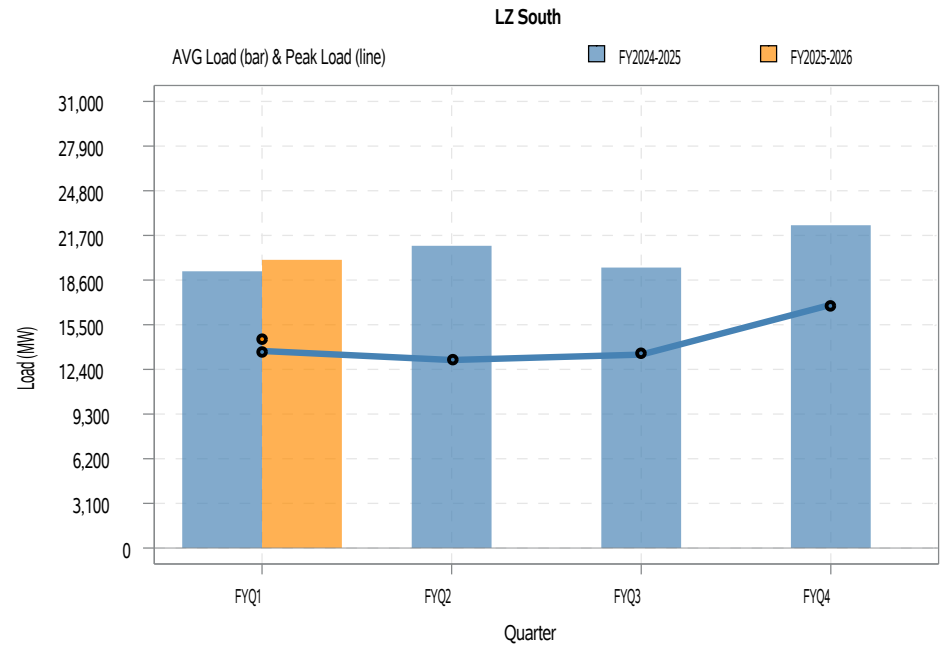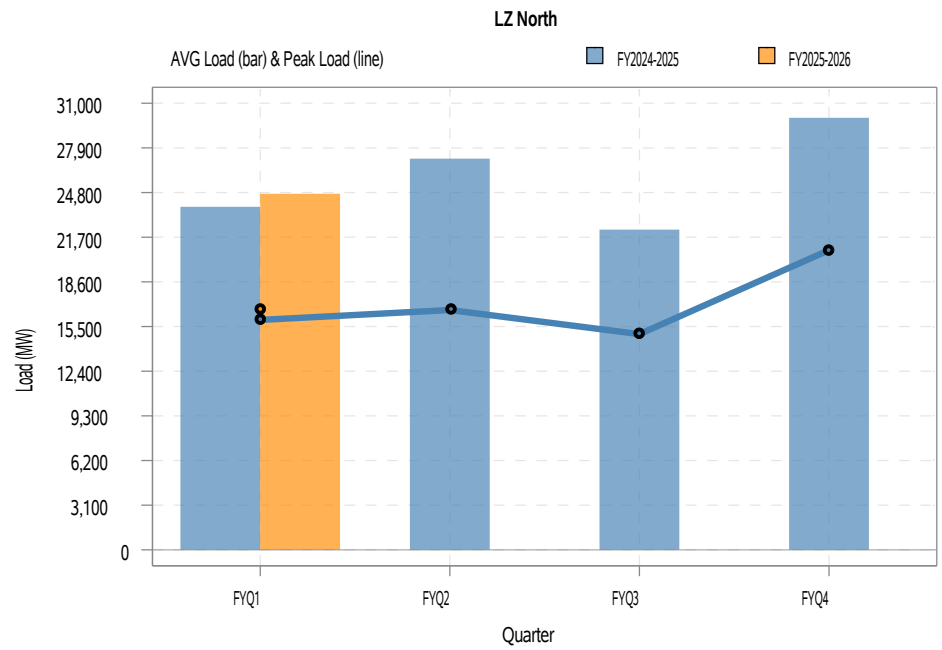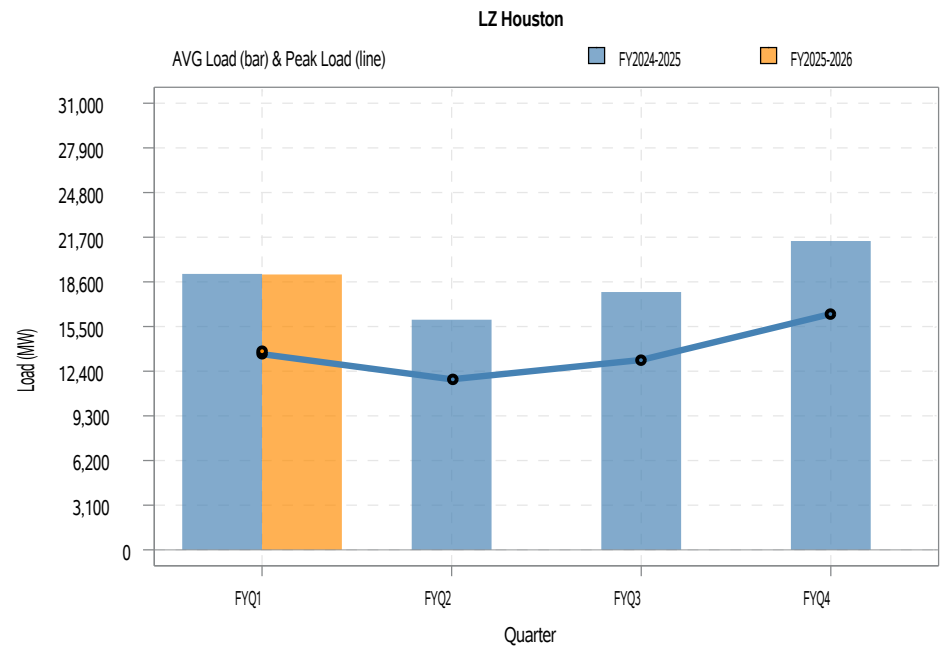






Reserve Shortage/Reliability Adders Average Values in FY2025-2026Q1

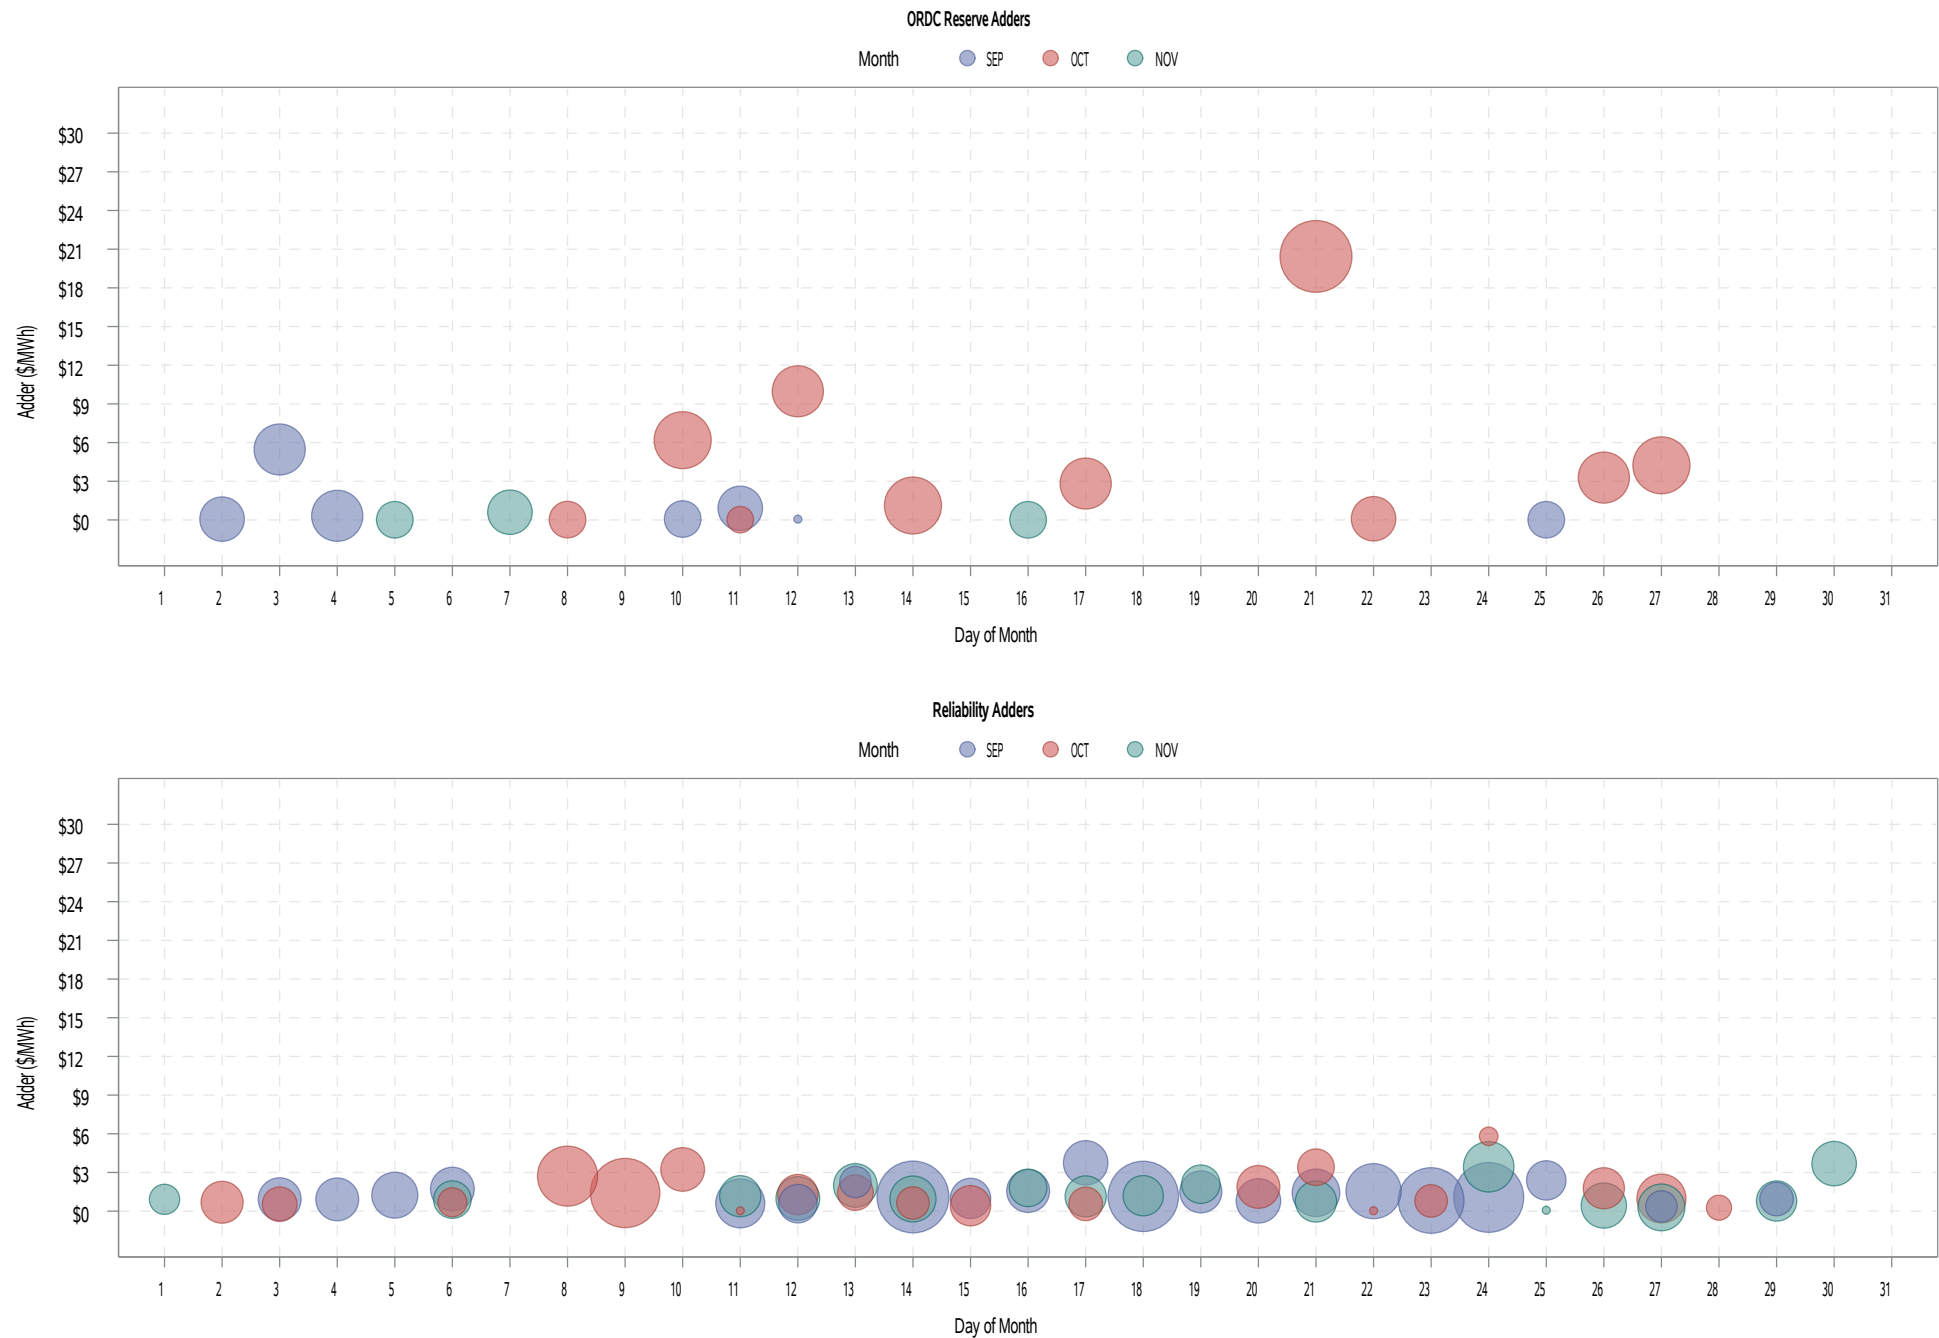


Quarterly Average of Ancillary Services Required MW

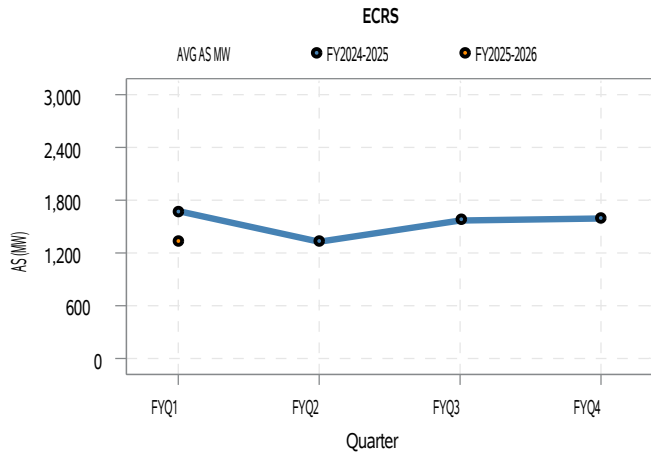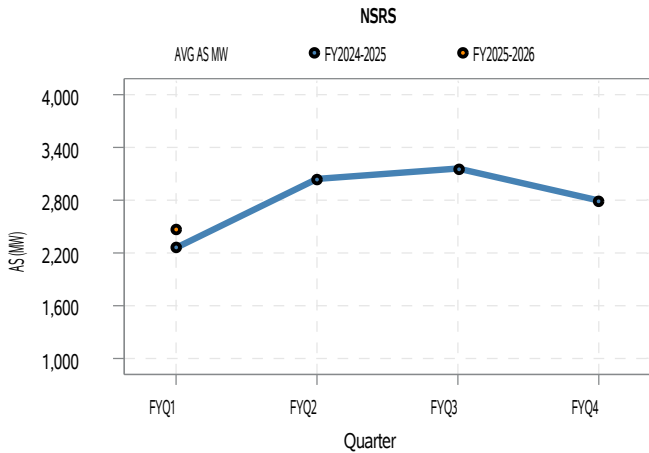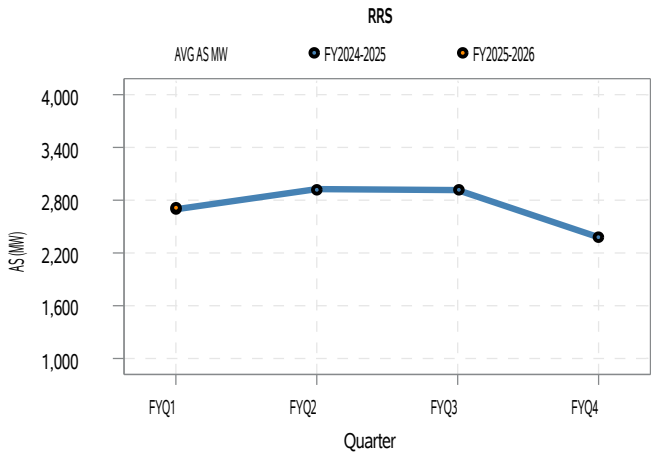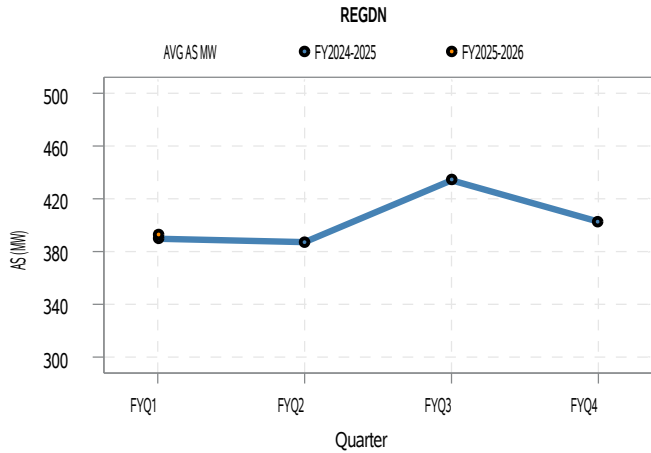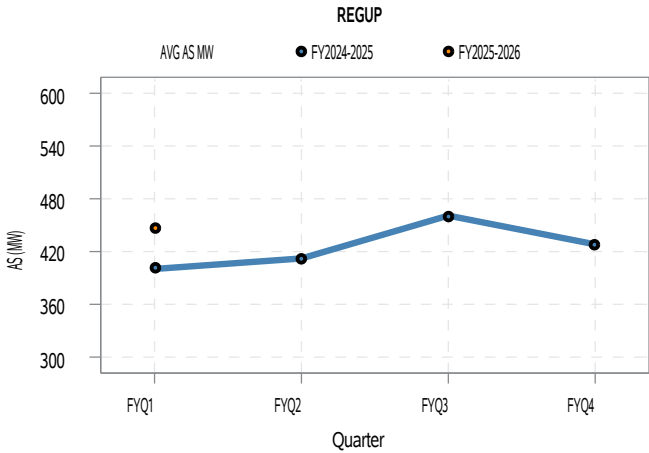


Quarterly Average of Ancillary Services Prices (MCPCs)

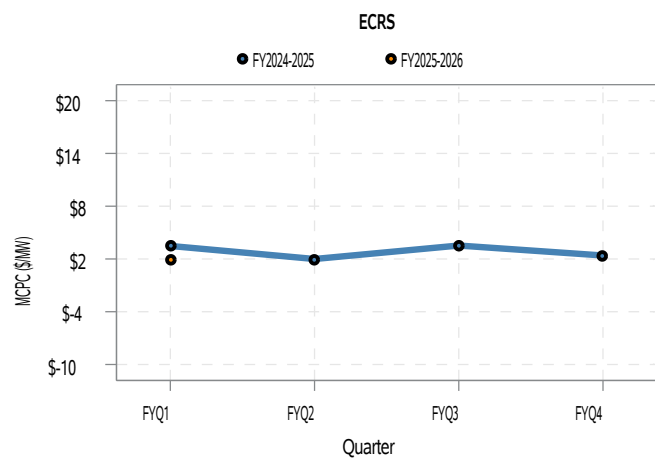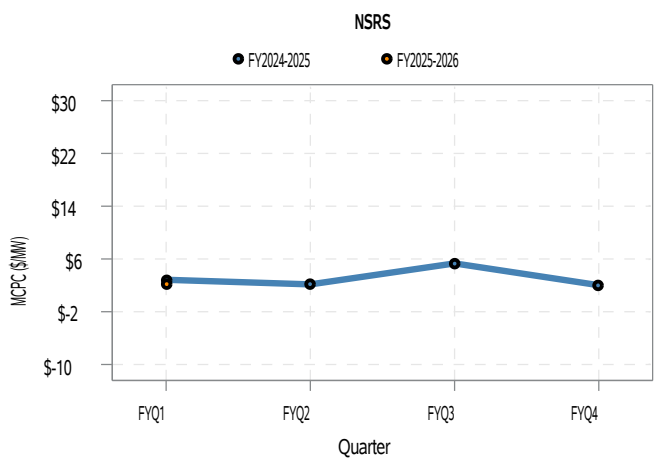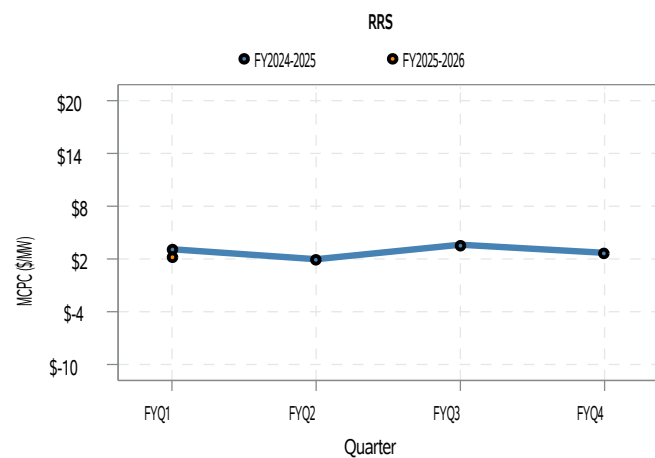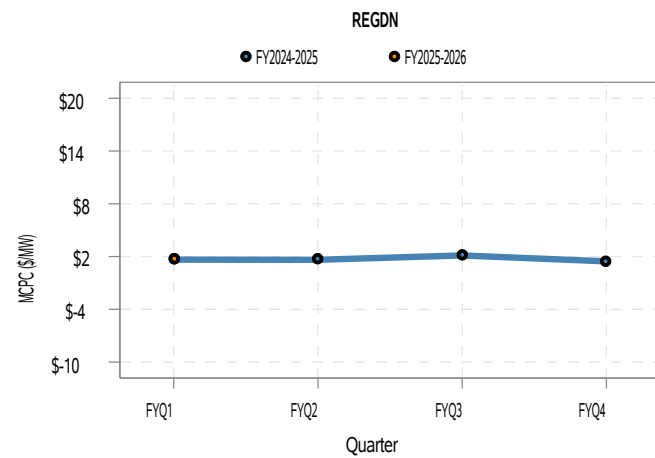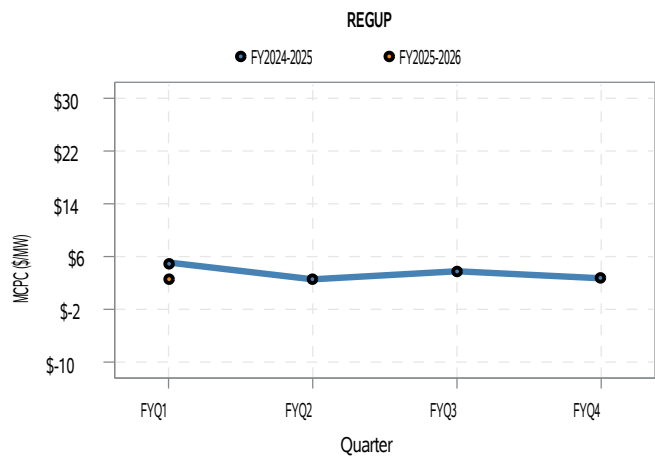

Quarterly Average Ancillary Services Cost per MWh Load

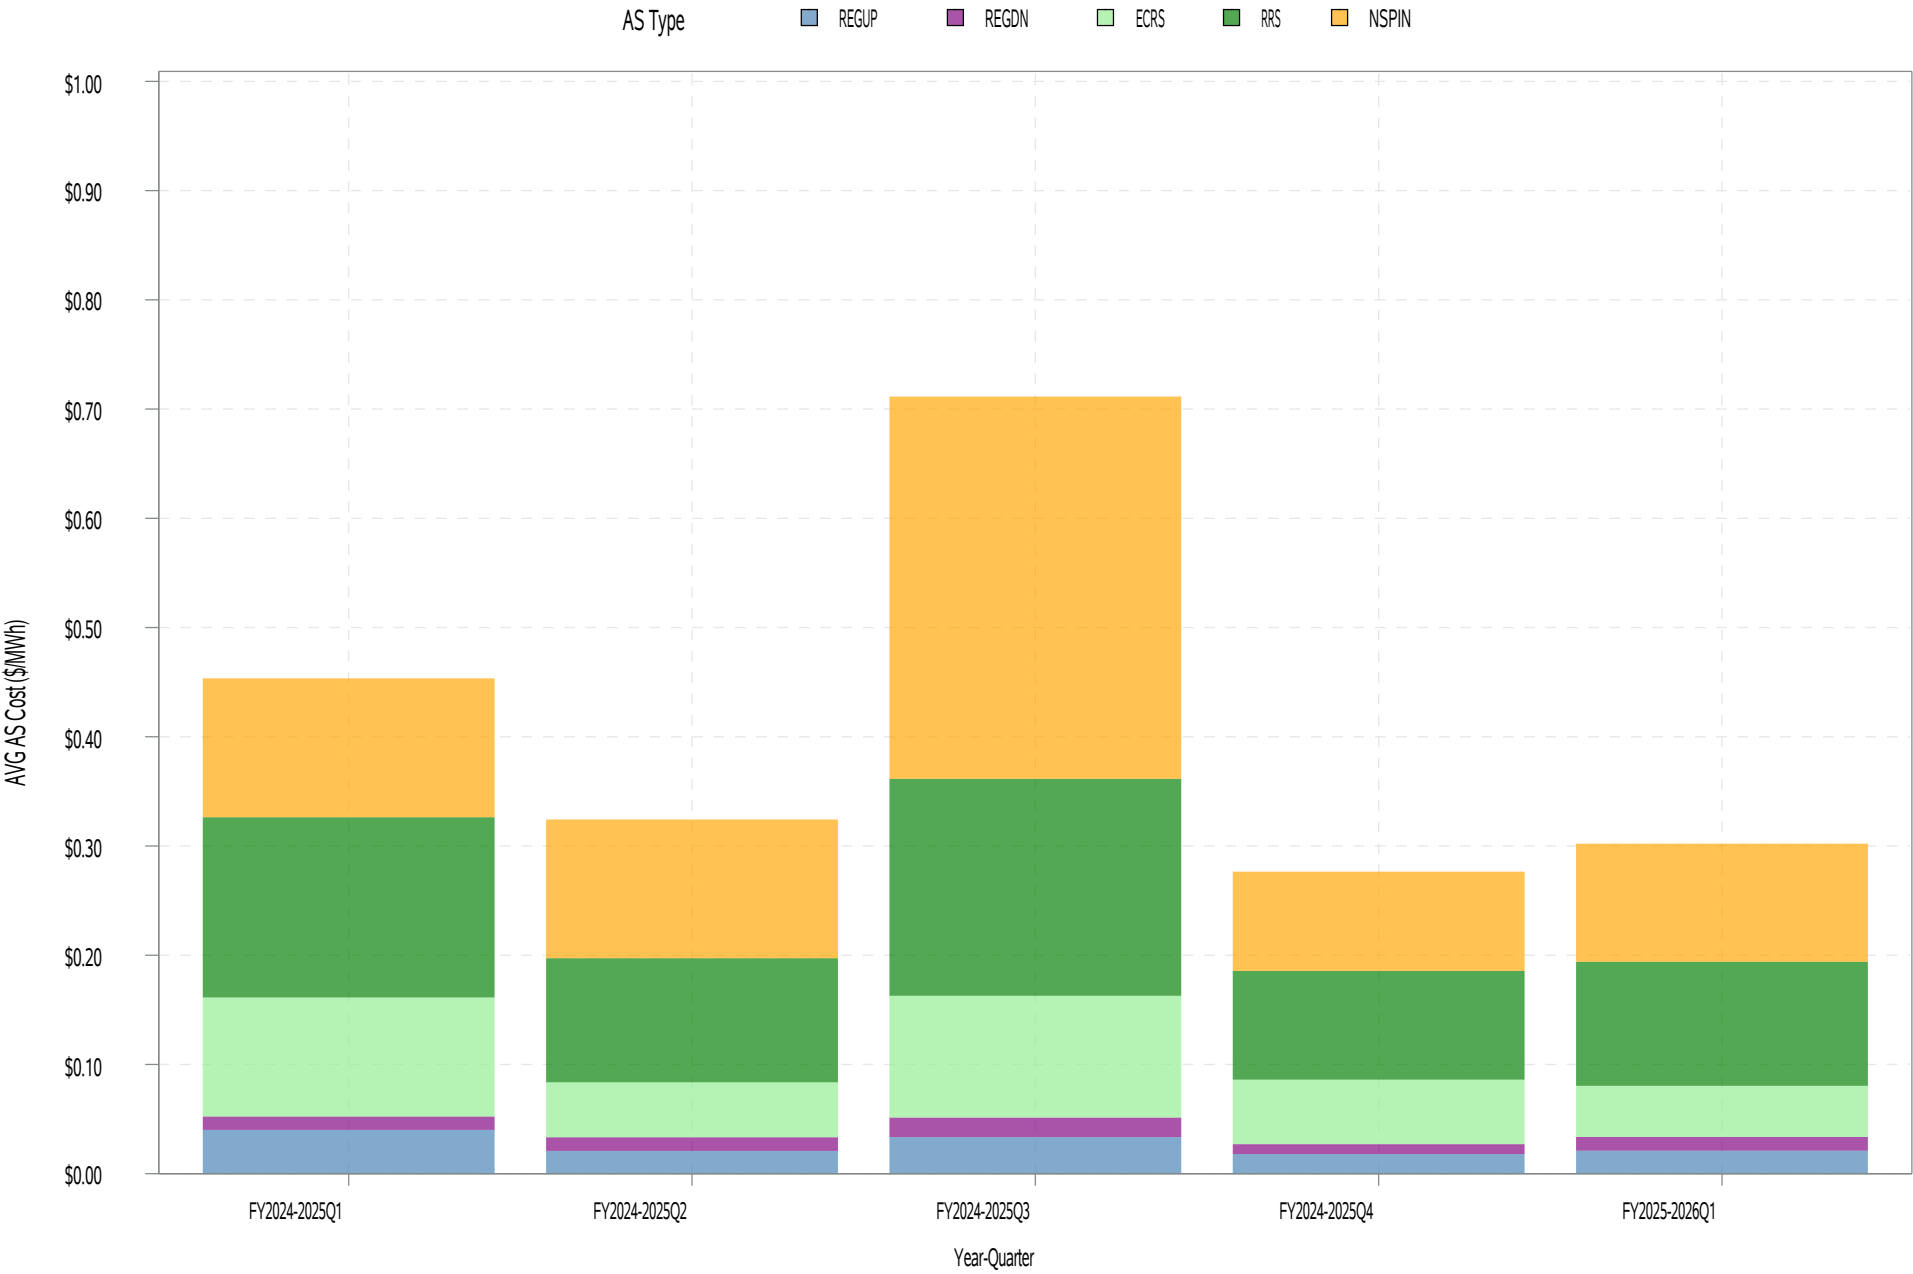

Quarterly Average DA vs. RT Load Forecast Error by Hour Ending

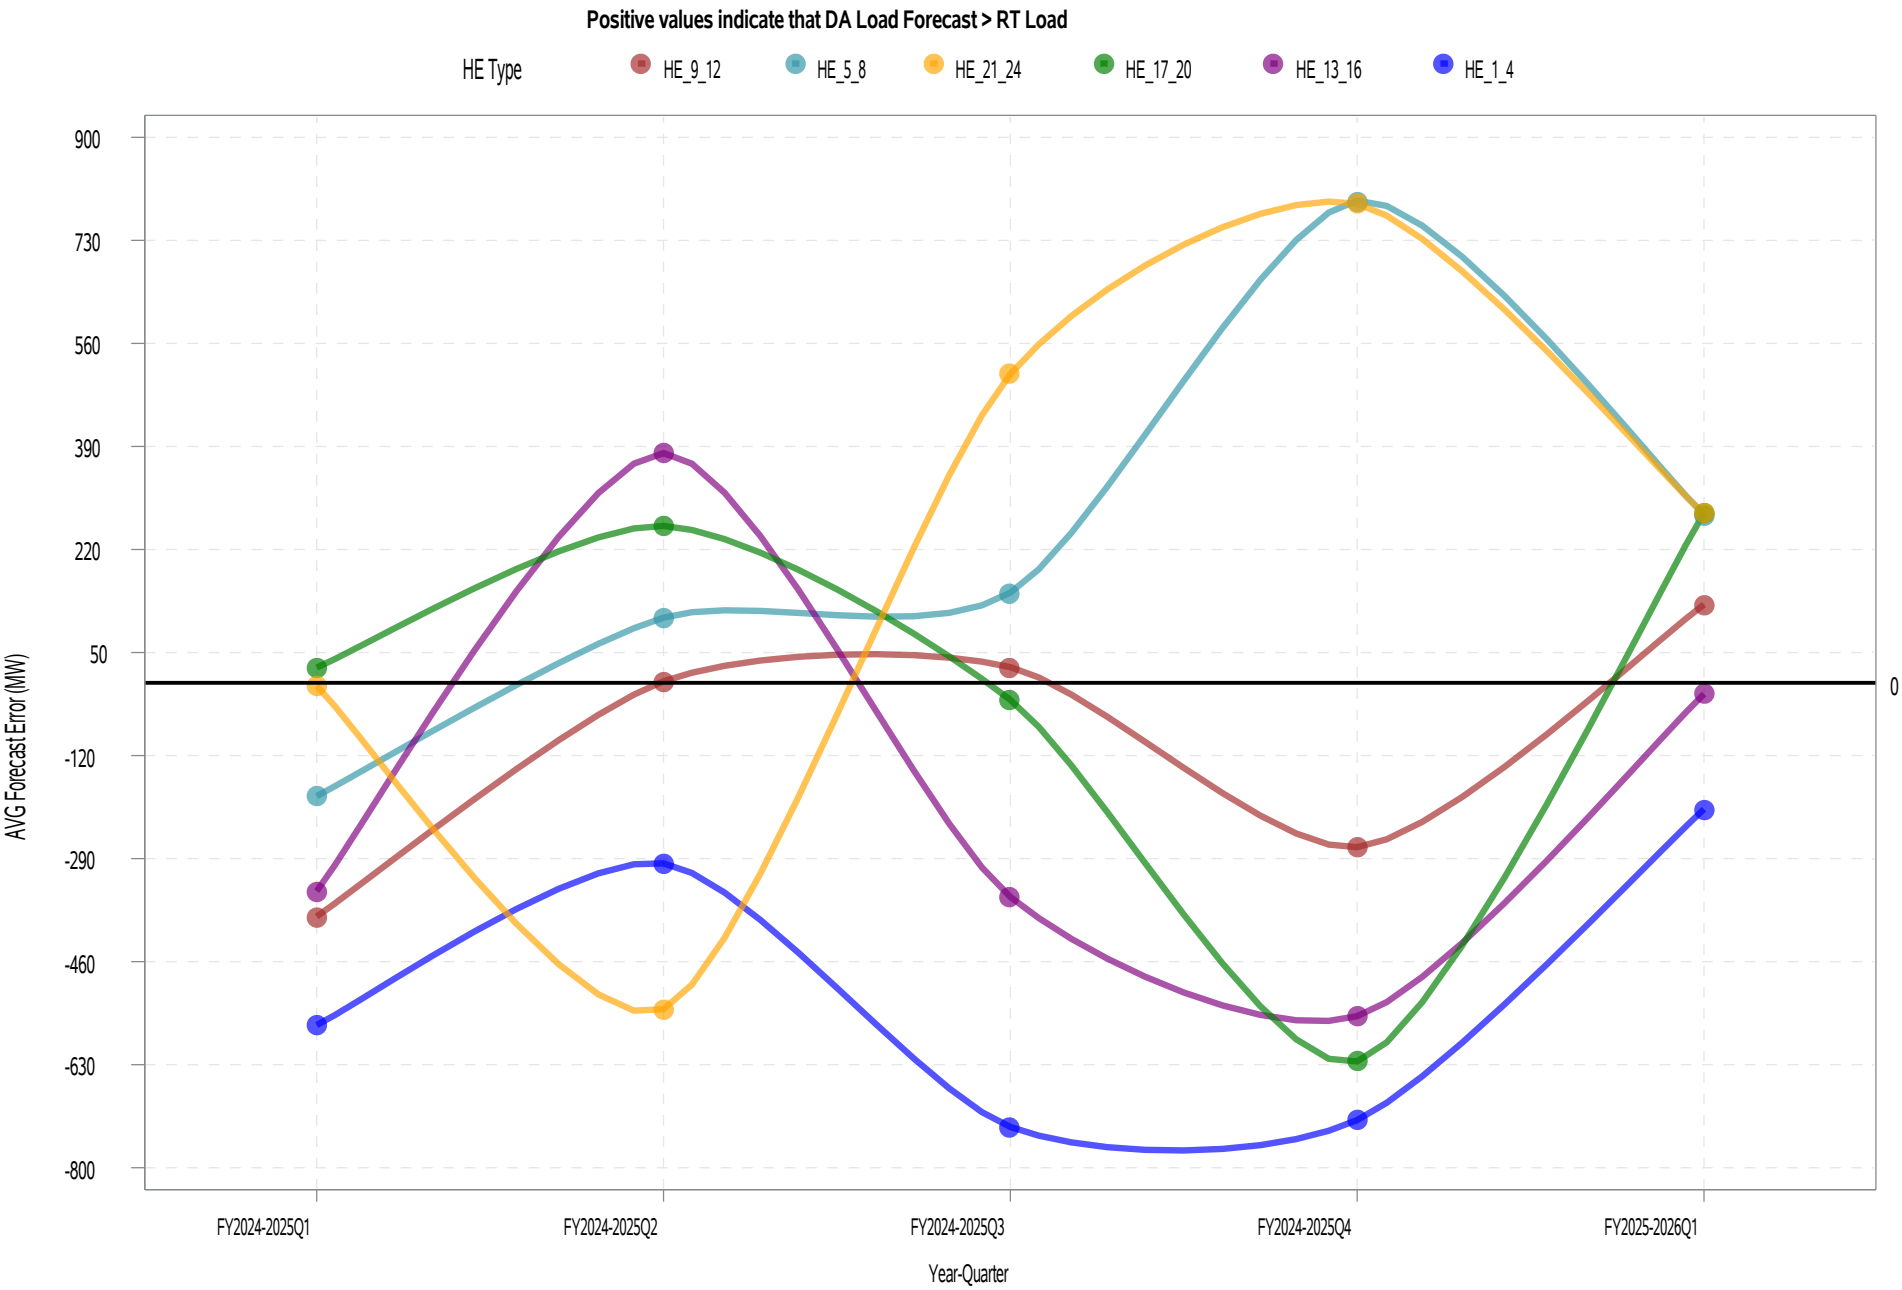



Quarterly Average of Wind Generation by Hour Ending

